



Note:  
 This drawing is the copyright of Morgan Carey Architects.  
 It may not be copied, reproduced or altered in any way without their written authority.  
 Do not scale for construction purposes - use figured dimensions.  
 Check dimensions on site before work proceeds. Report discrepancies to the Architects.  
 If in doubt, ask!



**FIRE SAFETY LEGEND**

- Fire extinguisher - Uictor - 9 litre size. Handles 1m above floor.
- Fire extinguisher - Dry powder - 4kg size. Handles 1m above floor.
- Fire extinguisher - CO2 - 2kg size. Handles 1m above floor.
- Fire blanket - BS5575. Base of container 1.5m above floor. Quick release container.
- Fire Notice - General
- Fire Notice - Staff
- Fire Notice - "KEEP LOCKED WHEN NOT IN USE"
- Notice on door - "FIRE DOOR KEEP SHUT"
- Notice on door - "AUTOMATIC FIRE DOOR - KEEP CLEAR - CLOSE AT NIGHT"
- Notice on door - "DOOR MUST BE SECURED OPEN WHEN PREMISES IN USE"
- Fire alarm call point.
- Audible Warning Device
- Fire alarm smoke detector - ionisation
- Fire alarm smoke detector - ionisation - with integral sounder
- Fire alarm heat detector - 85°C
- Fire alarm heat detector - Rate of rise.
- Fire alarm - optical smoke detector
- Fire alarm - smoke detector remote indicator
- Smoke detector
- Heat detector
- Bulkhead light - Primary lighting (maintained)
- Bulkhead light - Primary lighting - non maintained
- Internally Illuminated Exit Sign (Maintained)
- Area covered by Emergency lighting system
- Fire Alarm Slave Indicator Panel
- Fire Door - 30 minute with Smoke Seals
- Door - Self Closing
- Door - Provided with Magnetic hold open device
- Door - Provided with Self Closing device - Fire alarm or Power Failure operated
- Compartment walls
- Emergency Lighting - 1 Lux min.
- Fire Alarm Indicator Panel
- Fire Notice - "Fire Exit Keep Clear"
- Door Fitted With Immediately Openable Lock
- Fire Exit Directional Sign (Illuminated)
- Visual warning device

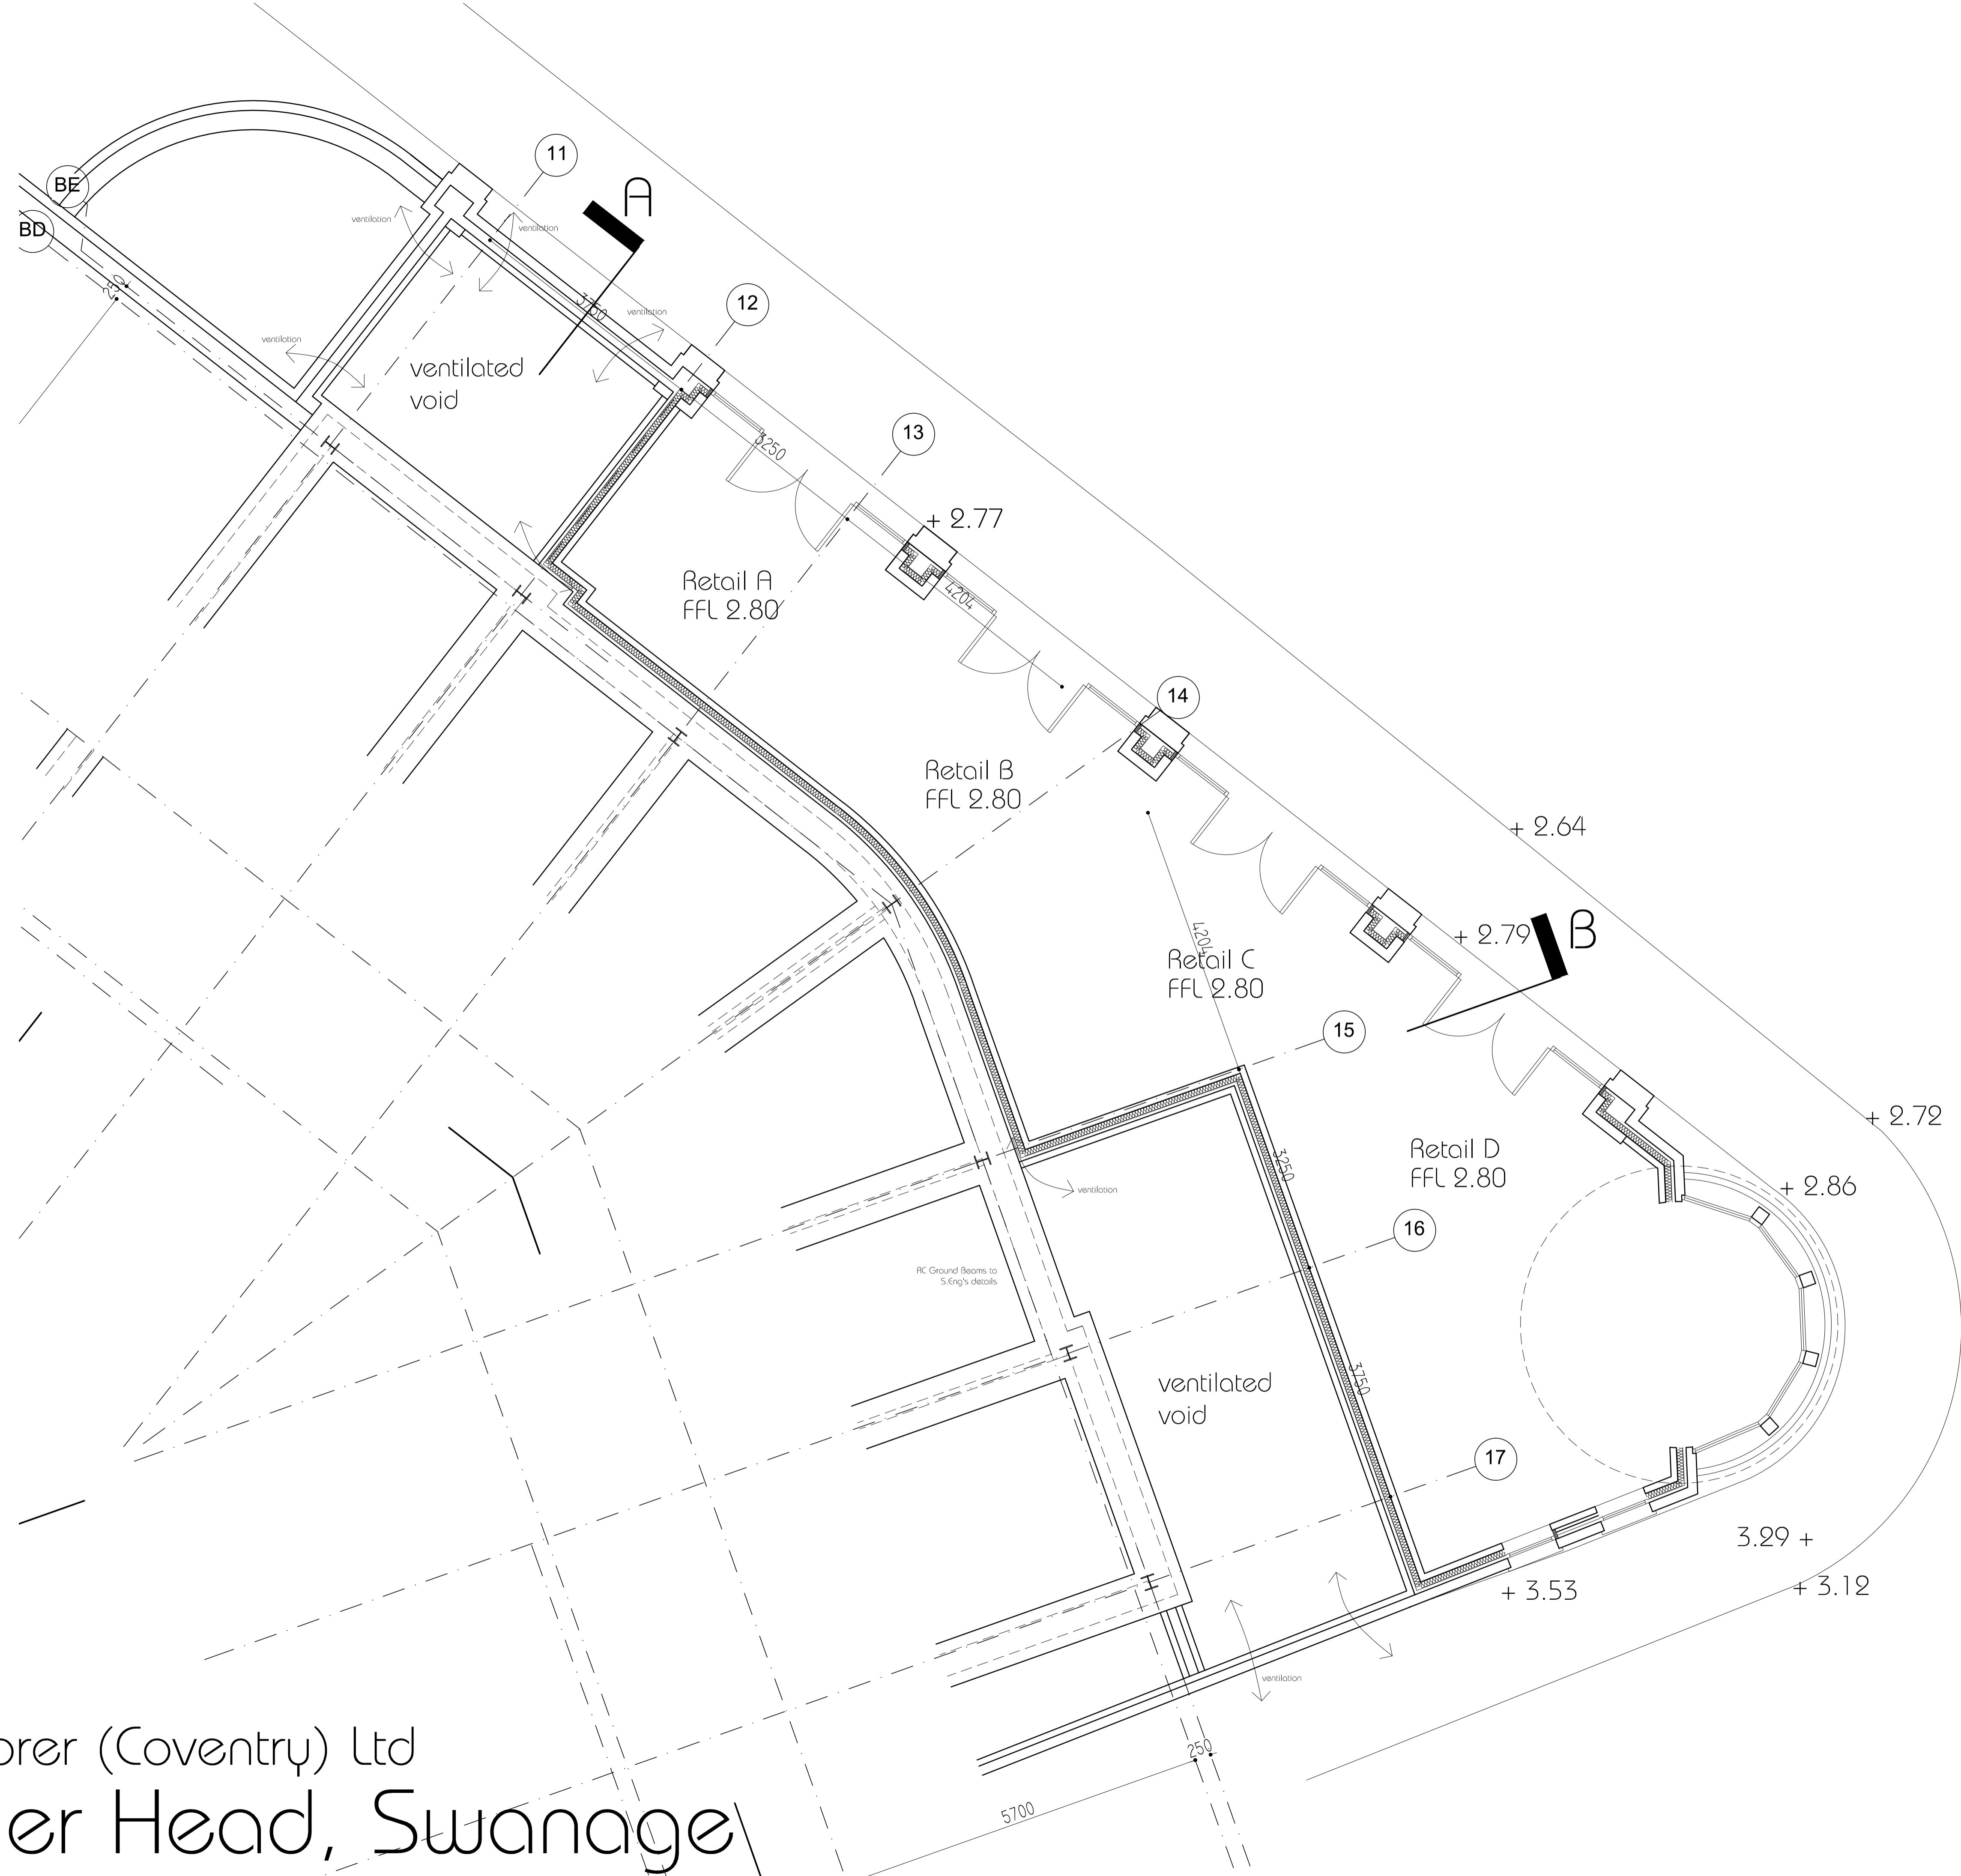

REFER TO SENG'S DETAILS AND GRIDLINE LAYOUT FOR RELATIONSHIP OF GRIDLINE TO EXTERNAL CAVITY WALL. TYPICALLY 25MM ECCENTRICITY TO INSIDE BLOCK WALL FACE OR COINCIDING WITH INNER BLOCK SKIN INTERNAL FACE.

**PRELIMINARY**

Rev	Date	Amendment

**MORGAN CAREY ARCHITECTS** with MCA Lawray  
 THE GOODS SHED  
 SANDFORD LANE  
 WAREHAM BH20 4DX  
 tel: 01929 557878  
 mca@morgancarey.co.uk  
 www.morgancarey.co.uk

Client  
 Storer (Coventry) Ltd

Project  
 Pier Head, Swanage  
 Eastern Block

Drawing  
 Proposed Lower Ground  
 Floor Plan

Scale: 1:50  
 Date: Oct 15  
 Drawing File: 12146.160P1

Storer (Coventry) Ltd  
 Pier Head, Swanage